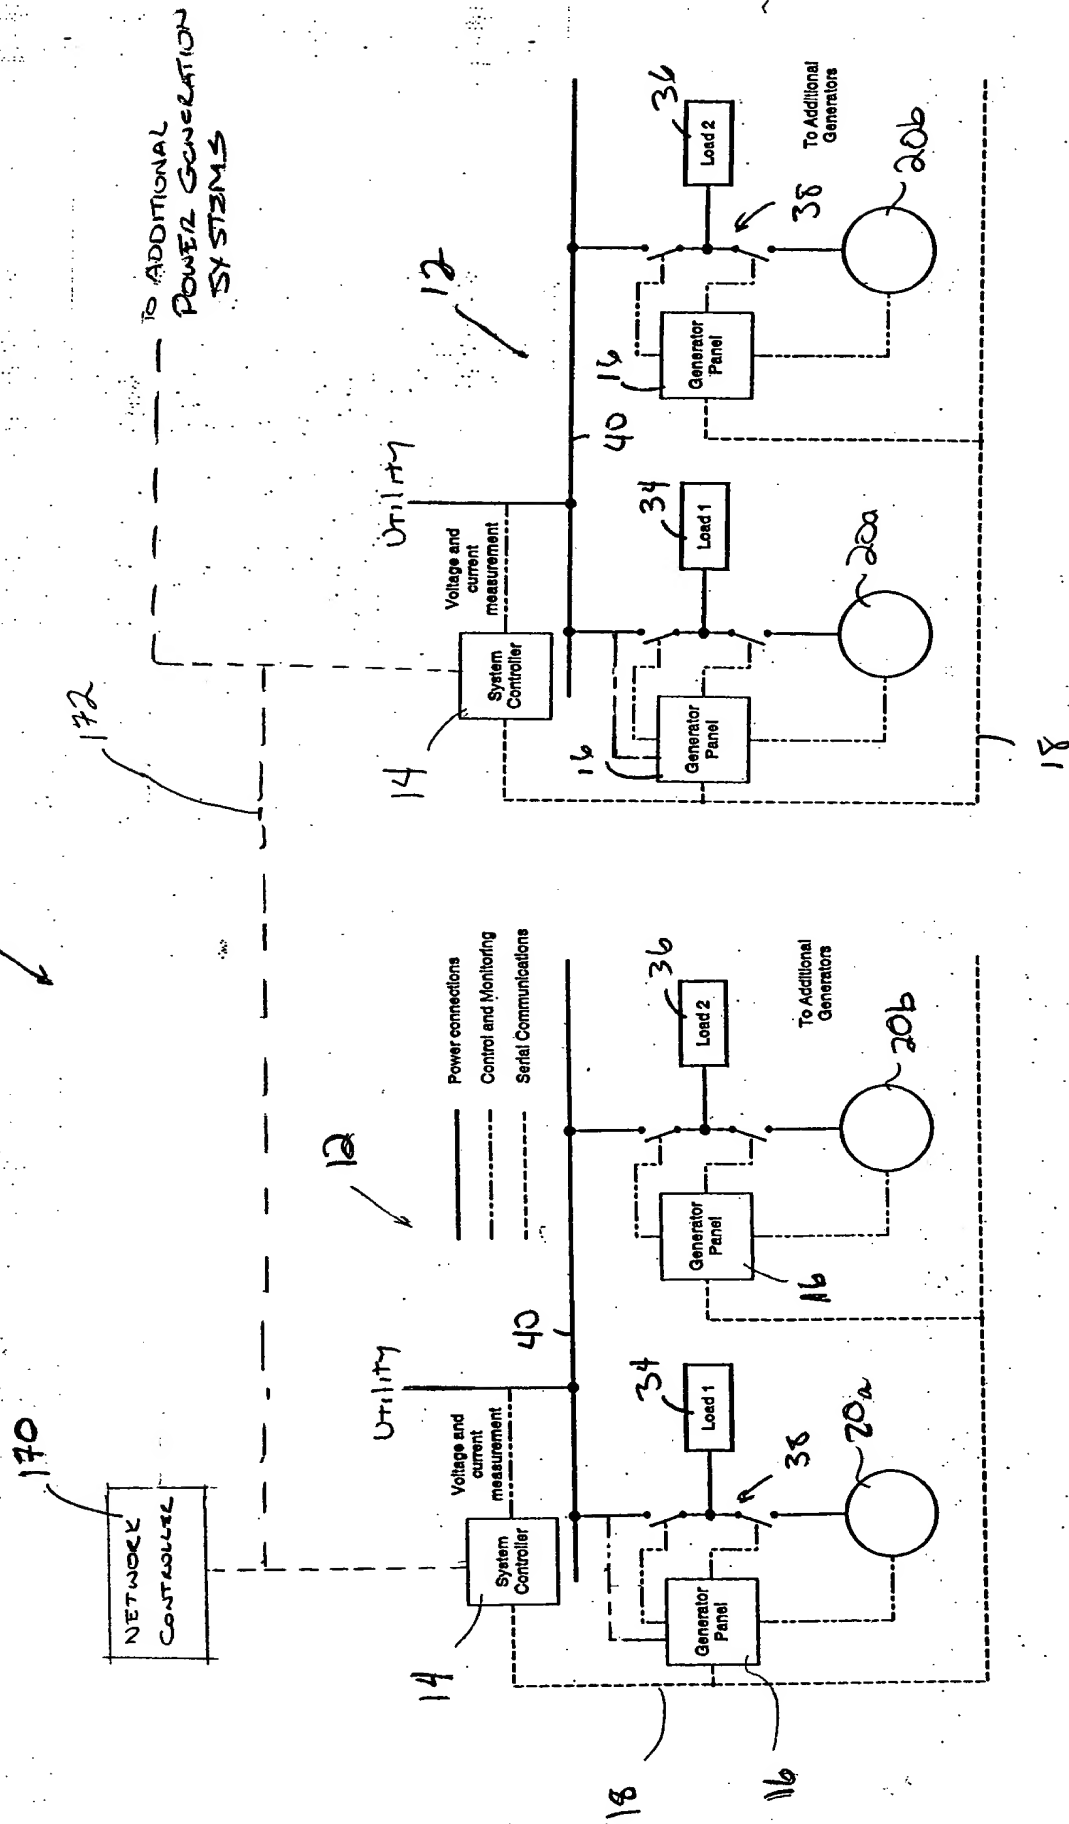
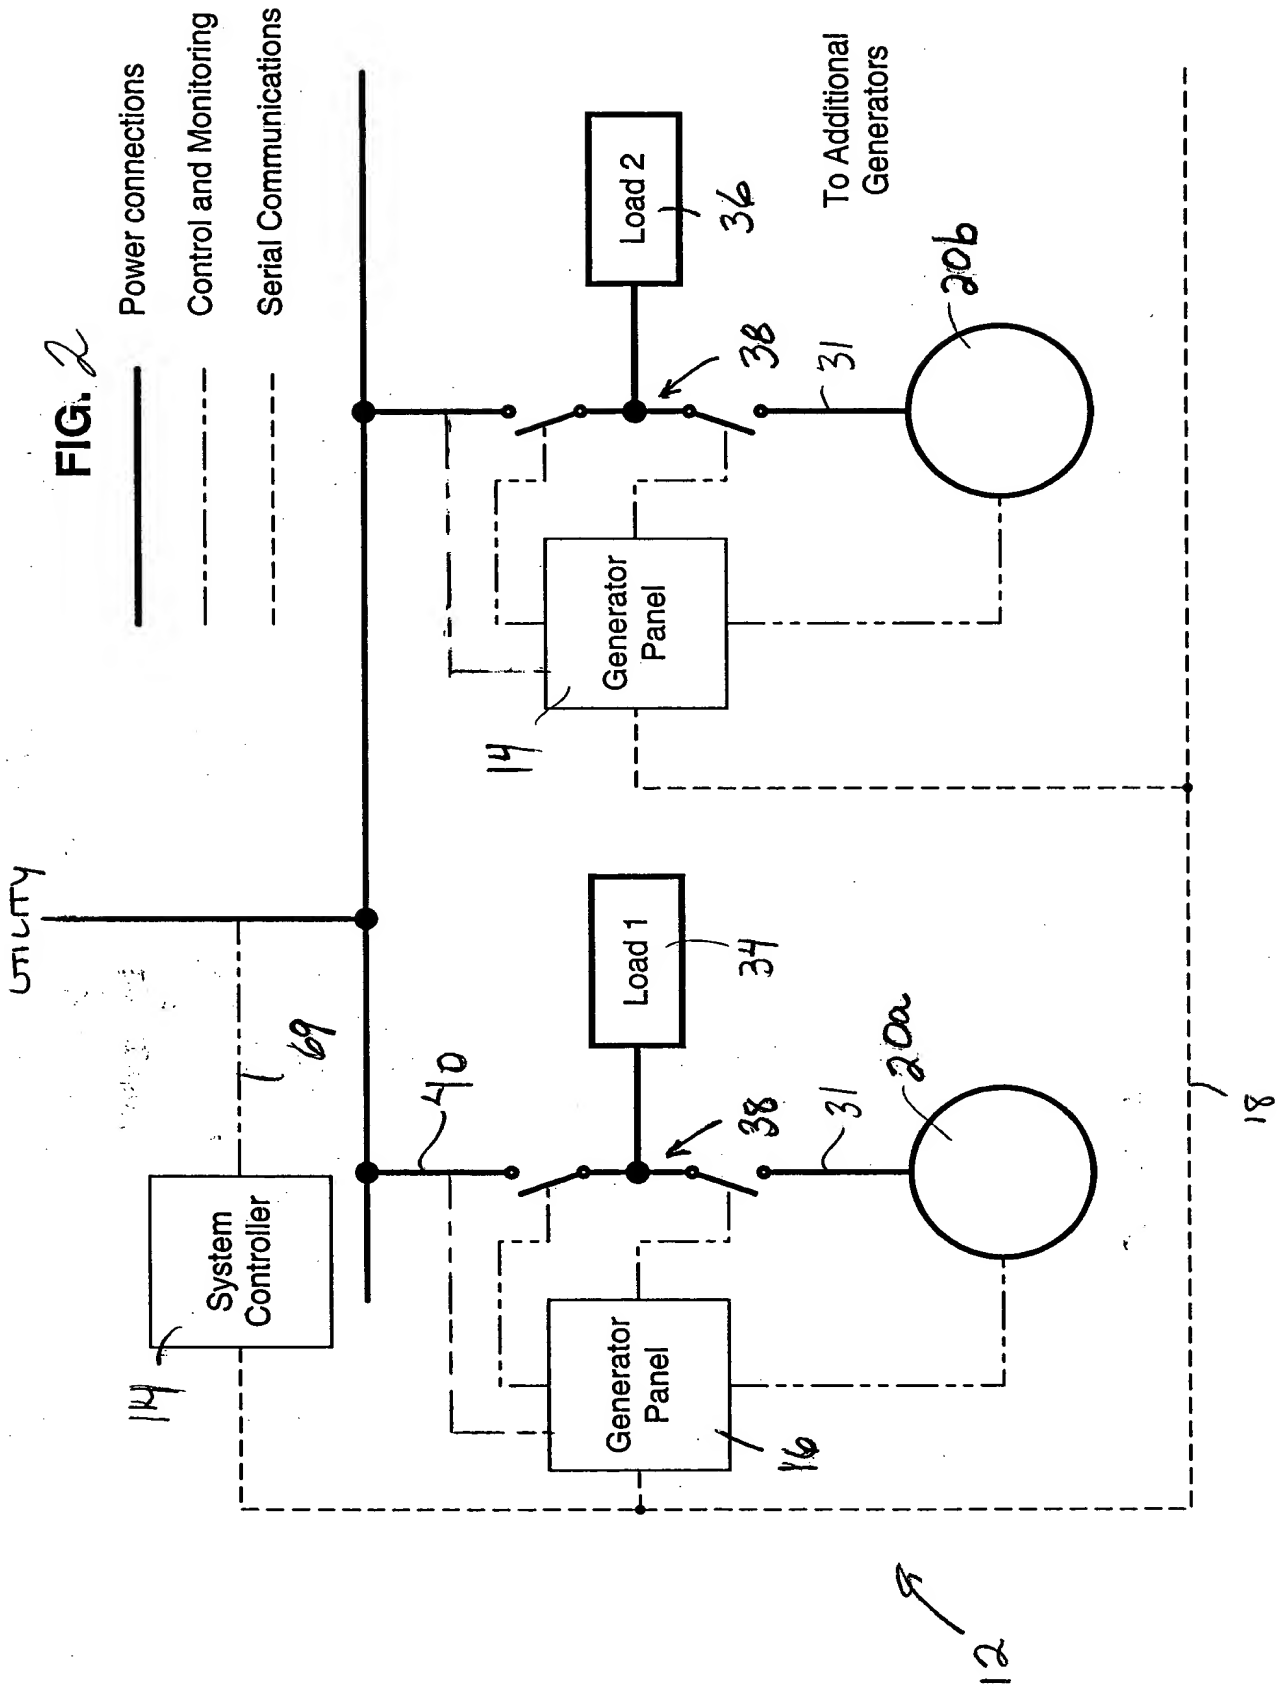
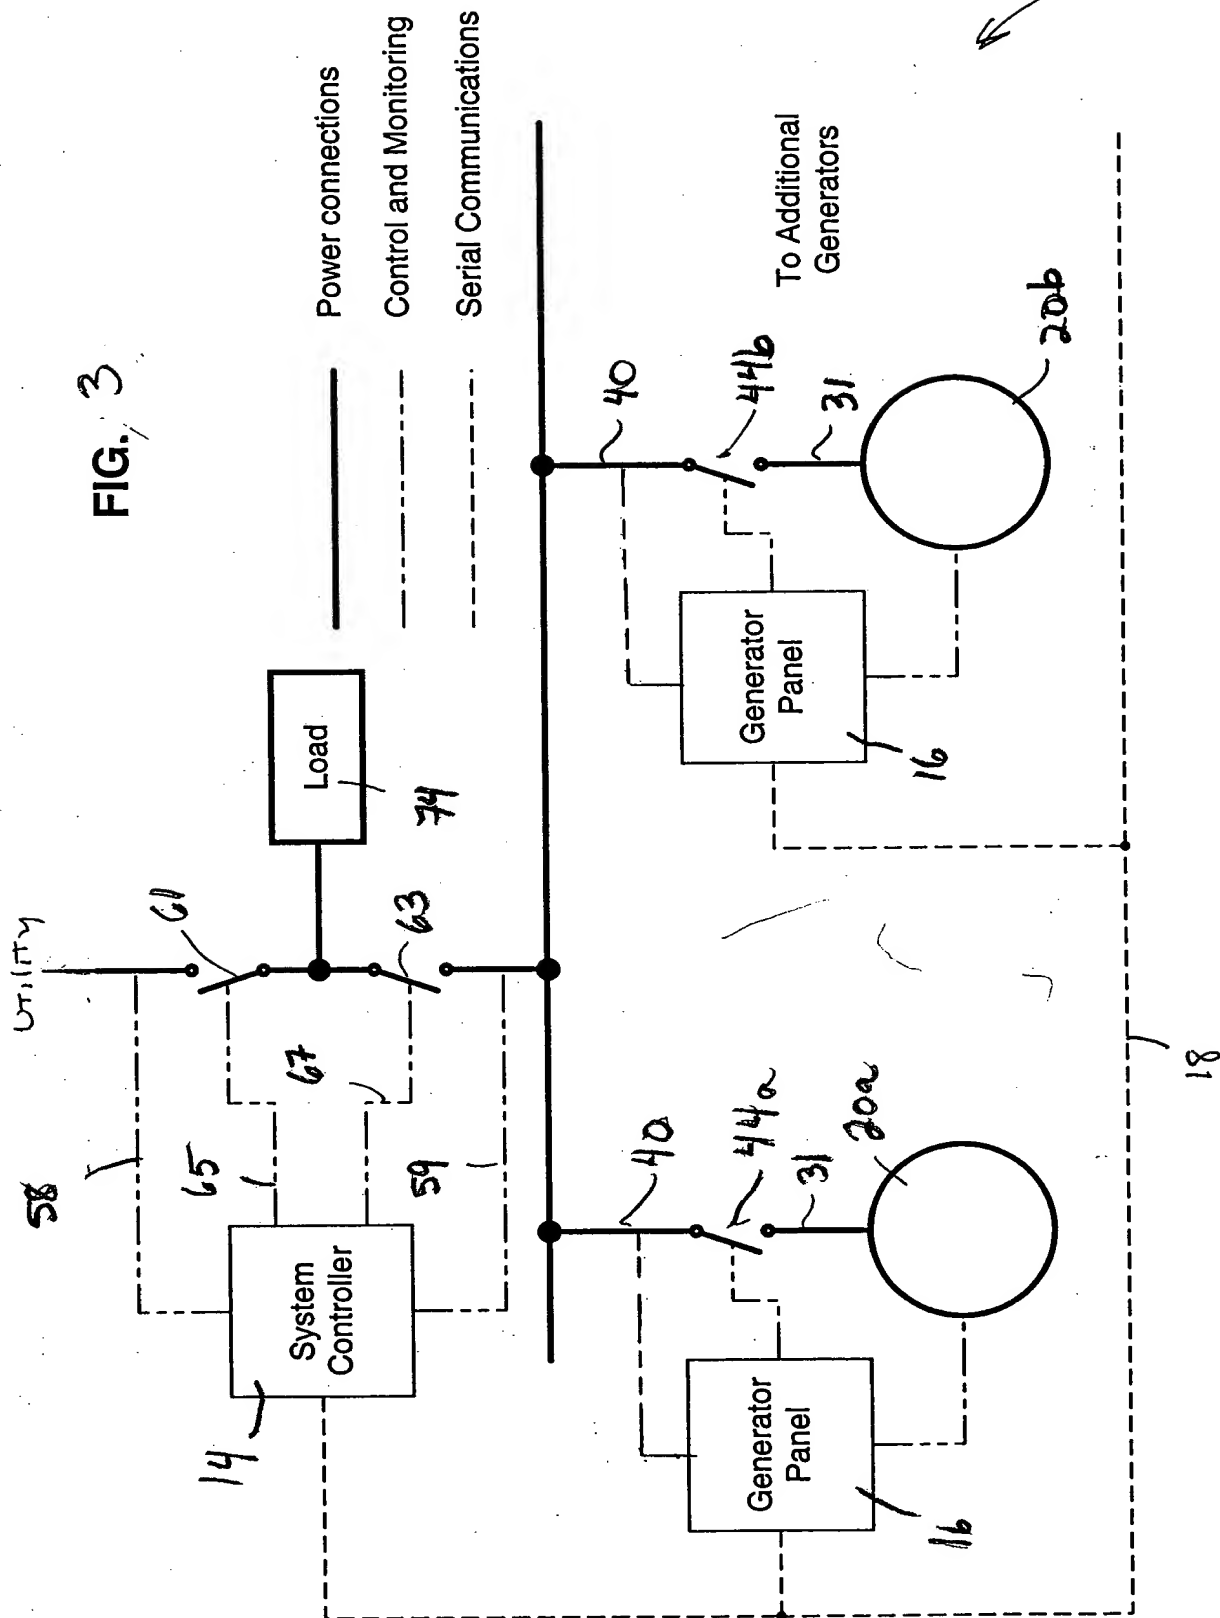


Fig. 1







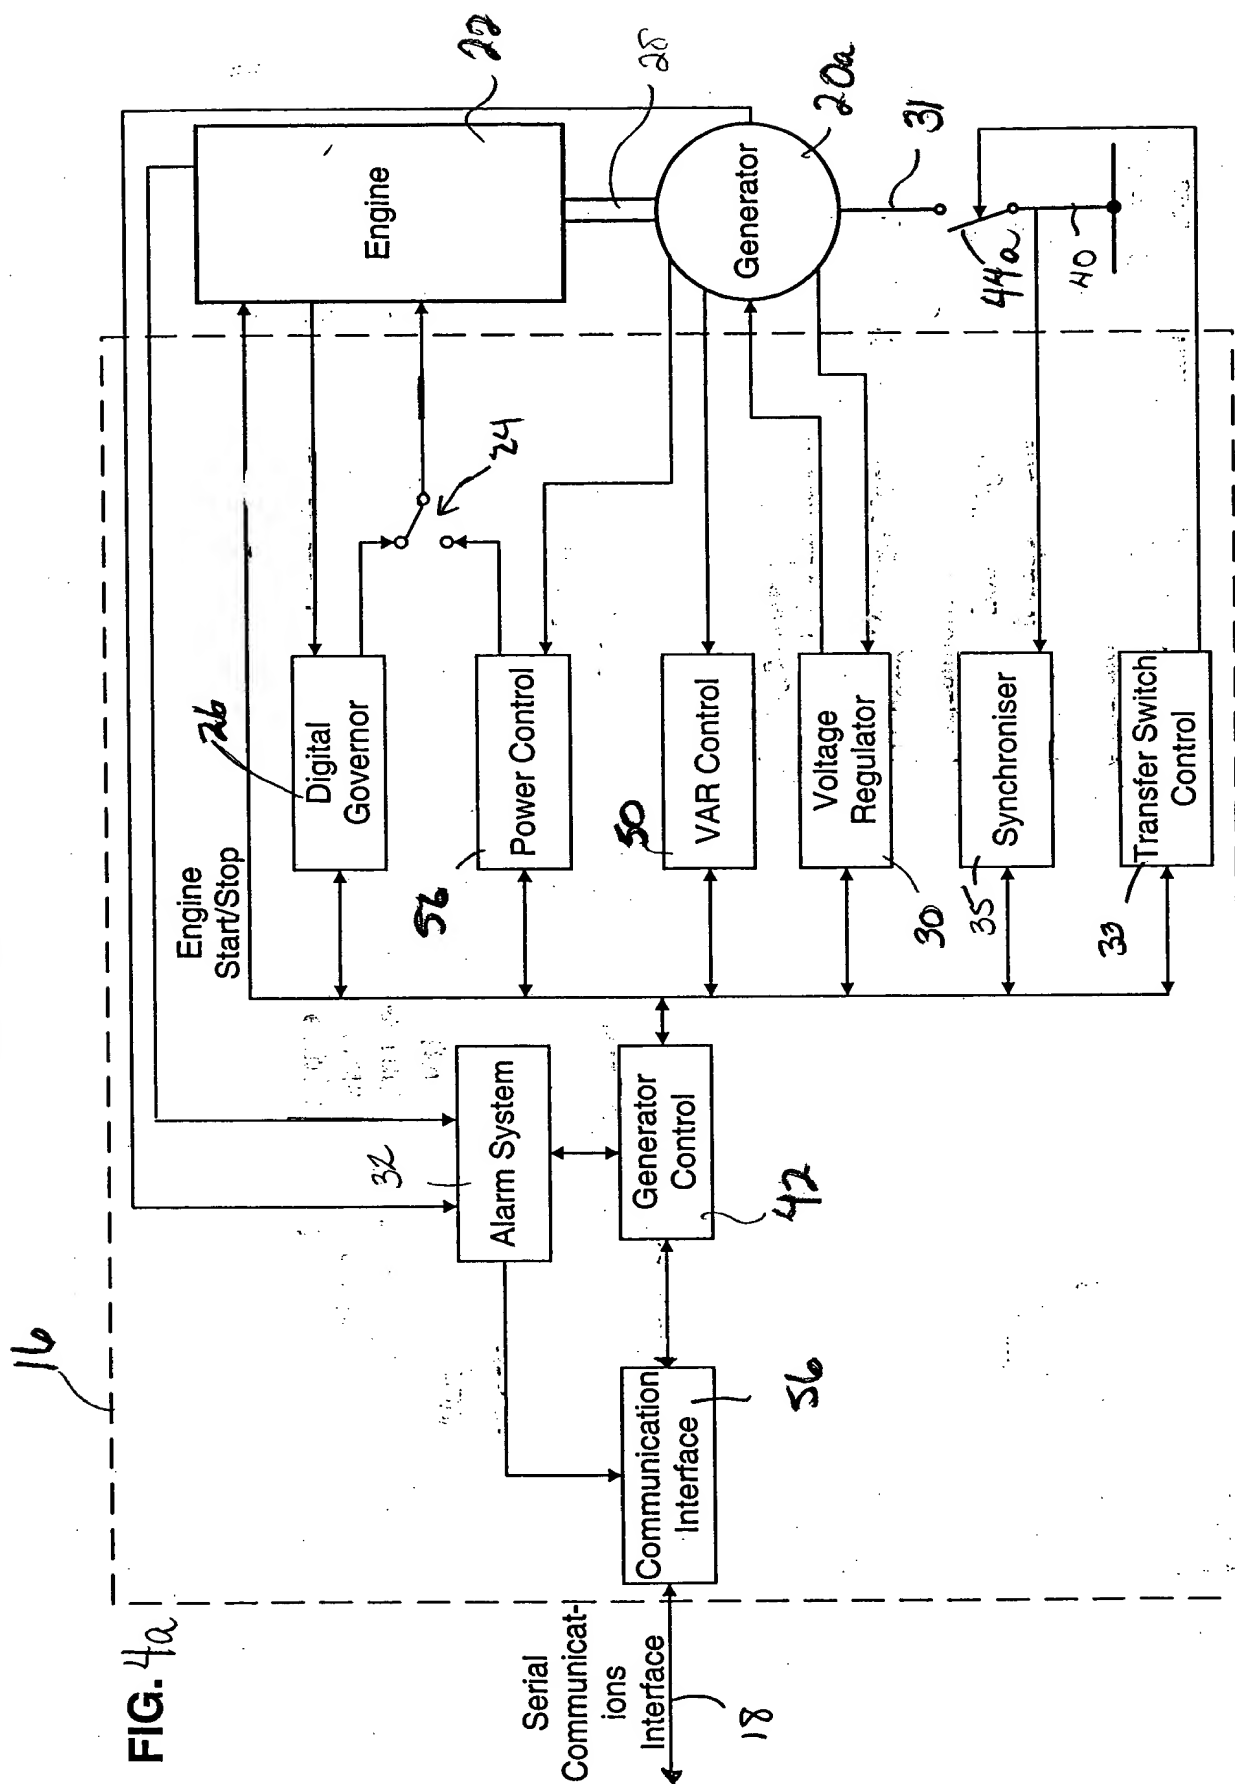


FIG. 4b

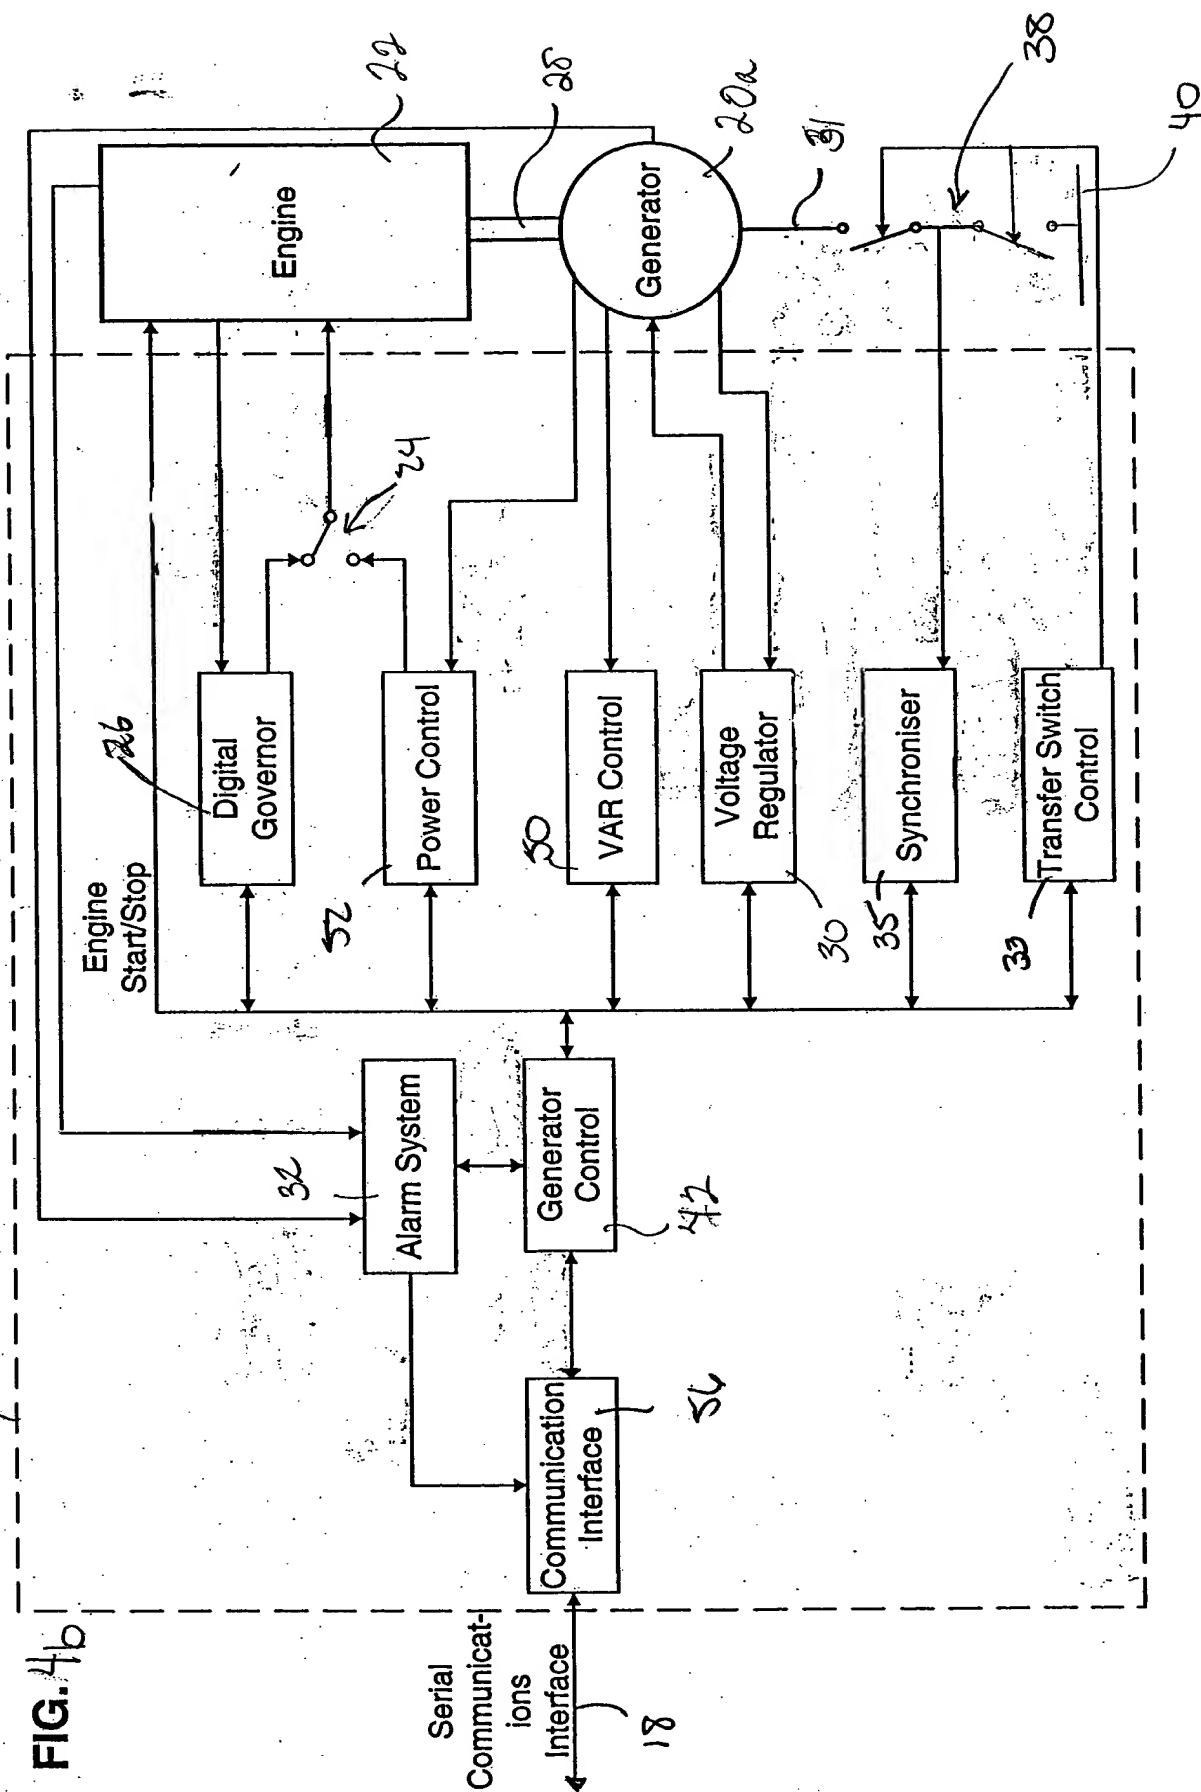


Fig. 5


86

70

66

64

68

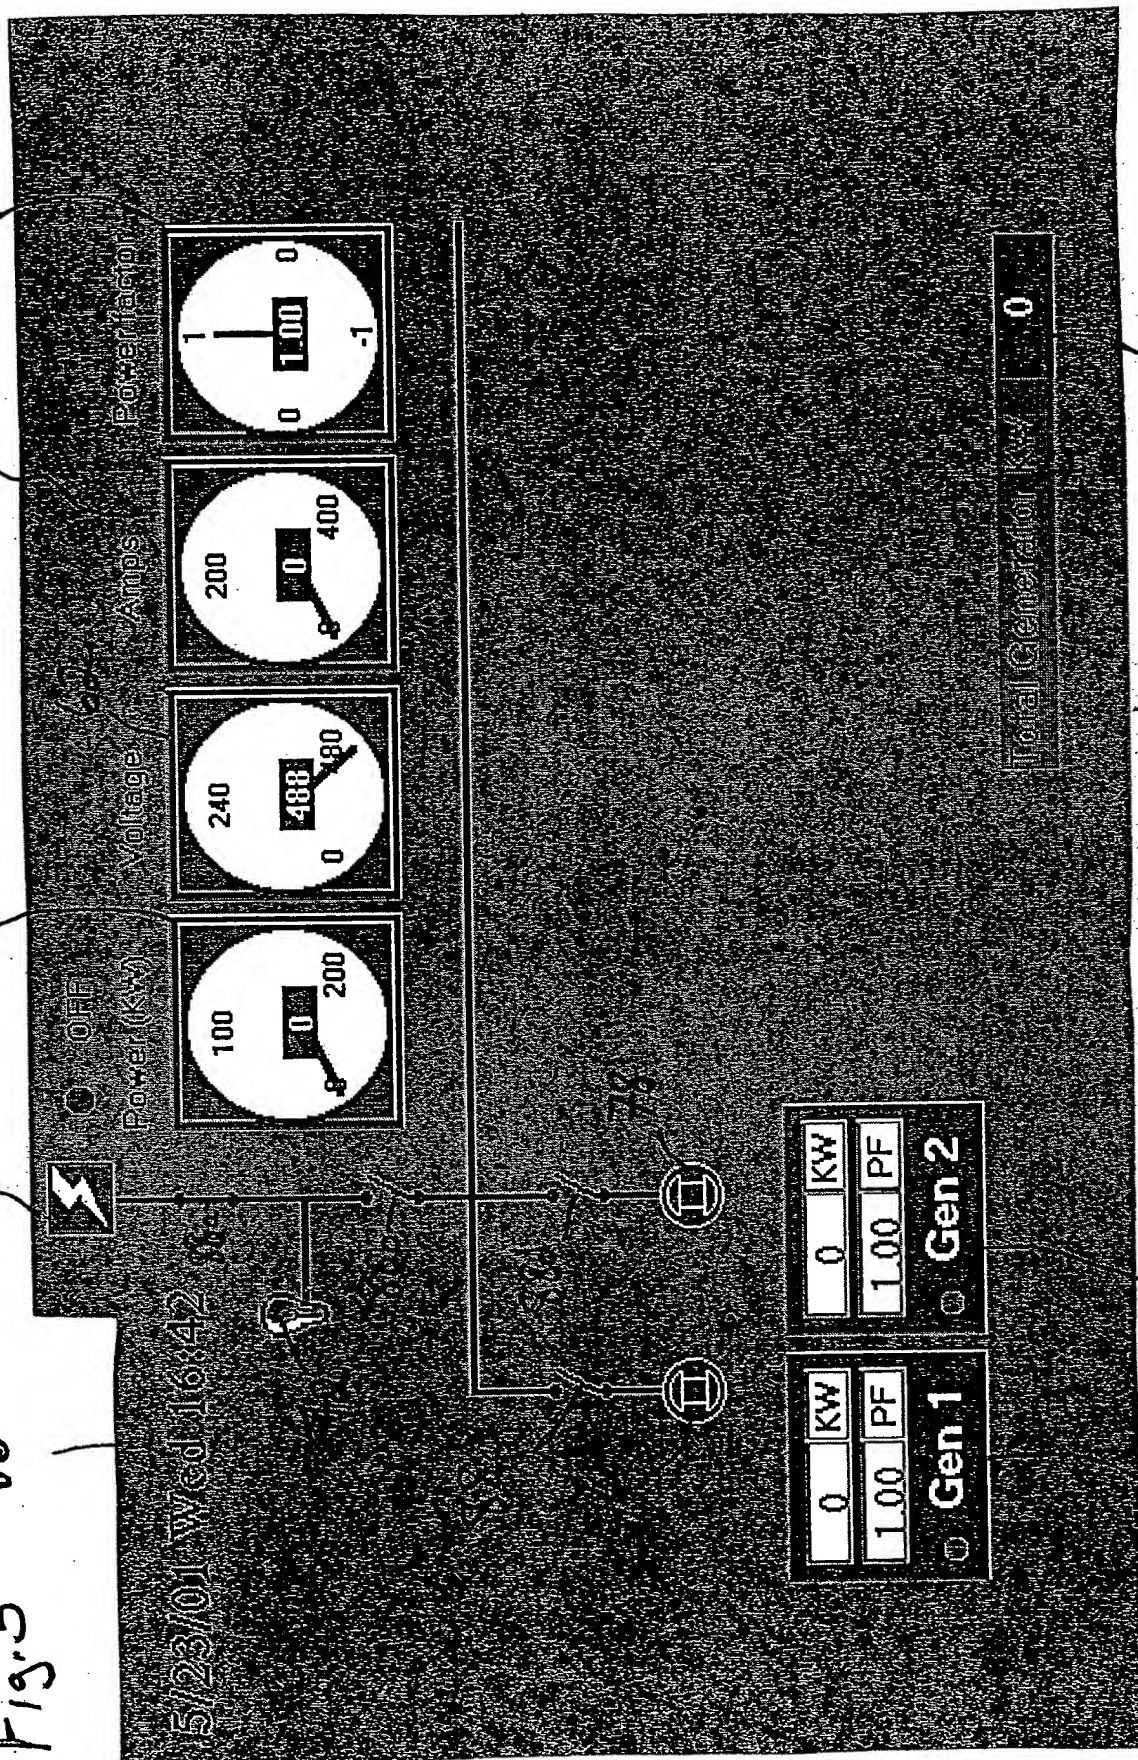

DECEMBER 30, 2000

Generator Settings		Command Settings		Holiday		System Settings	
Generator Settings				Number of Generators			
GenID	1	0%			2		
MaxKw	50	0%					
MinKw	10	0%					
MaxVAR	30	100					
Priority	1	0%					
Subaddress	1	0%					
Generator Settings: < >				New Report Delete			

Fig. 6 105 90

Default Setting		Command Setting		Holiday		System Setting	
Command Setting							
Command ID	103						
Command Mode	Base load						
kW Limit	50	12	119	Power factor		1.1	
Start date	Jan	1	1	Day			
End date	Dec	31	12	Day			
Start time	8	12	0	Min			
Stop time	20	12	0	Min			
Excluded days	<input checked="" type="checkbox"/>	St	<input checked="" type="checkbox"/>	Mo	<input checked="" type="checkbox"/>	Th	Sa
Holiday							
Command Setting							
New				Reset			
Delete							

Fig. 7

131 132a 132b 132c 132d 132e 132f 132g 132h 106

General Settings

Holidays

System Settings

Holiday Settings

Holiday ID

Month

Day

1

Jan

1

1

Feb

1

1

Mar

1

1

Apr

1

1

May

1

1

Jun

1

1

Jul

1

1

Aug

1

1

Sep

1

1

Oct

1

1

Nov

1

1

Dec

1

New

Edit

Delete

Fig. 8

137

134

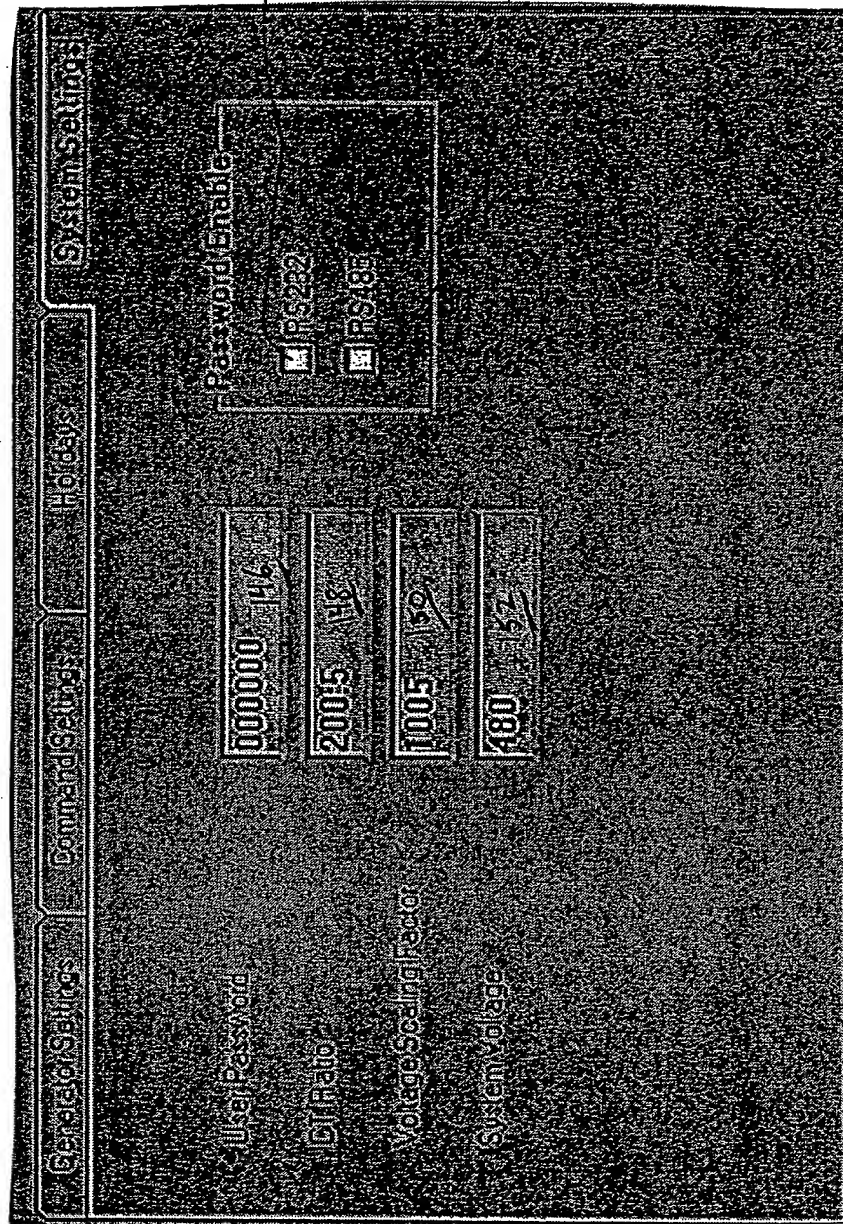
[illegible]

Fig. 9

242

FIG. 10

158

156

154

June 2000						
Sun	Mon	Tue	Wed	Thu	Fri	Sat
28	29	30	31	1	2	3
4	5	6	7	8	9	10
11	12	13	14	15	16	17
18	19	20	21	22	23	24
25	26	27	28	29	30	1
2	3	4	5	6	7	8

Today: 12/15/00

Month: Dec

Day: 15

Year: 00

Hour: 12

Min: 00

Sec: 00

WeekDay: Fri

Time: 12:00:00

Fig. 10